



IMPORTANT LINKS TO THE DRINKING WATER AND GROUNDWATER BUREAU WEBSITE

To provide its customers with the most current and accurate Public Water System (PWS) information, the Drinking Water and Groundwater Bureau encourages those associated with water systems to use the following links:

Public Water System (PWS) Information

Available on the One Stop Data Retrieval is Public Water System Information. Review the opposite side of this form to find your PWS Information .

Accredited Laboratories

Drinking water analysis must be performed by accredited laboratory that submit data electronically. A list of accredited labs that submit electronically is available at the following link:

<http://des.nh.gov/organization/divisions/water/dwgb/documents/accredited-labs-esamples.pdf> .

NH Sample Collection and Preservation Manual

To assist you in the proper collection of public drinking water samples, this manual summarizes minimum standards that must be used to collect samples. Containers, preservation, and holding times are included in this document.

This manual may be viewed at the following website

<http://des.nh.gov/organization/commissioner/pip/publications/co/documents/r-co-01-5.pdf>.

DPHS PUBLIC HEALTH LABORATORIES

Sample bottles, specific to each water test, can be obtained from an accredited lab. If you choose to use the State Laboratory, please order your bottles by calling (603) 271-3445, (603) 271-3446 or online at the following website:

<http://www2.des.state.nh.us/DESONestop> .

Reminders Emails

First Reminder emails will be automatically generated and sent on the following dates:

*1st of January, April, July, and October - **Lead/Copper** reminders for that quarter or compliance period*

*15th of every month - **Bacteria** reminders for monthly samples*

*15th of February, May, August and November - **Chemical** requirements for that quarter will be included with the monthly bacteria information*

Second Reminder emails will be automatically generated and sent on the following dates:

22nd of March, June, September and December - Last call for chemical and Lead/Copper samples to be collected and results submitted

DES Contact Information:

Chemical Monitoring:

- **Deb McDonnell** (603) 271-6703 email at deb.mcdonnell@des.nh.gov

Bacteria Monitoring:

- **Barbara Davis** (603) 271-2542 email at barbara.davis@des.nh.gov



Lead & Copper:

- **Joan Fitzsimmons** (603) 271-2516 email at joan.fitzsimmons@des.nh.gov

SOC & VOC Waiver Program:



- **Debra Sonderegger** (603) 271-2862 email at debra.sonderegger@des.nh.gov

Rye Water District PWS ID # 2041010

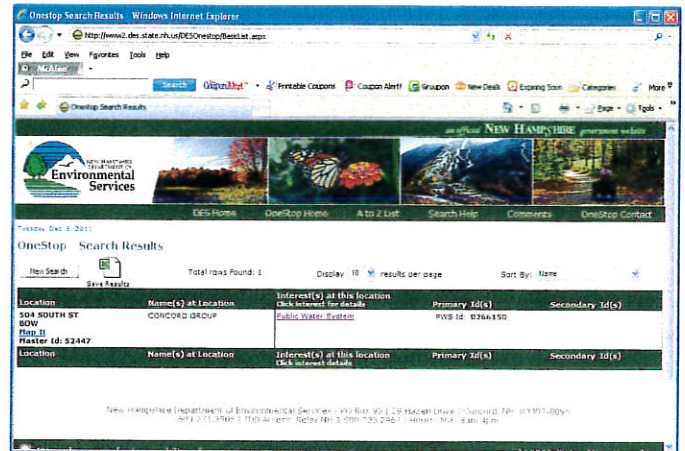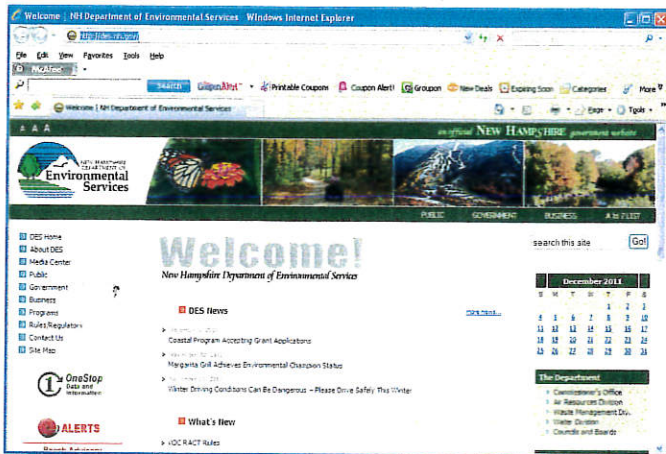



Type in this link <http://des.nh.gov/>

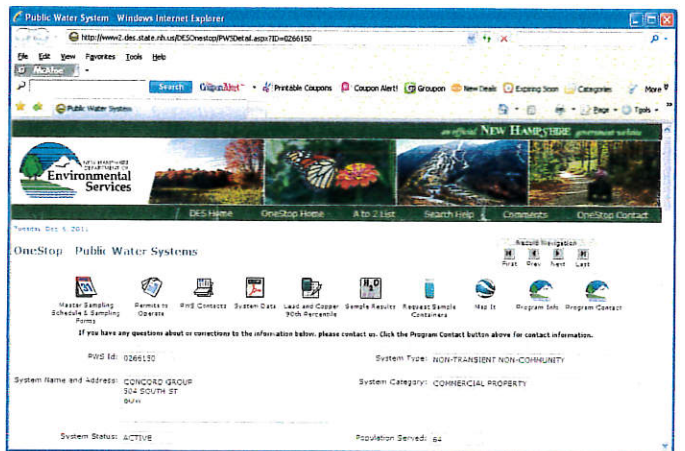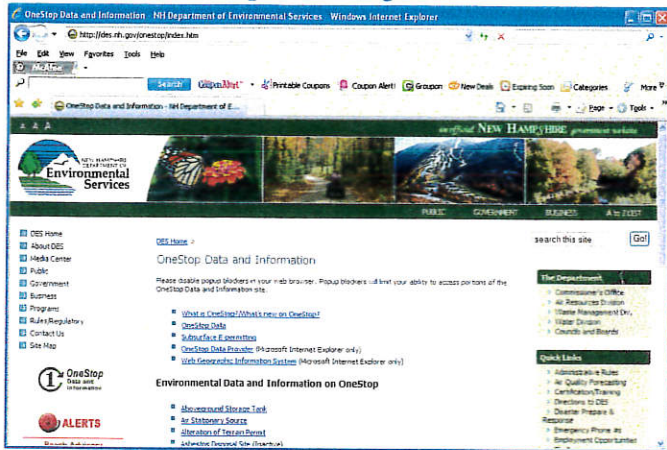
Click on Public Water System





Click on One Stop data


The stapled document  linked to the systems' PTO applications and licenses.

The Rolodex  linked to the systems' contact information.

The calendar  linked to the systems' sampling schedules and forms.

The H_2O  links to the laboratory results. Only samples analyzed at the state lab will be displayed.

The calculator  linked to the Lead and Copper 90th percentile records. Review of the 90th percentile records is the method EPA developed to determine whether or not the lead and copper levels present a health risk.

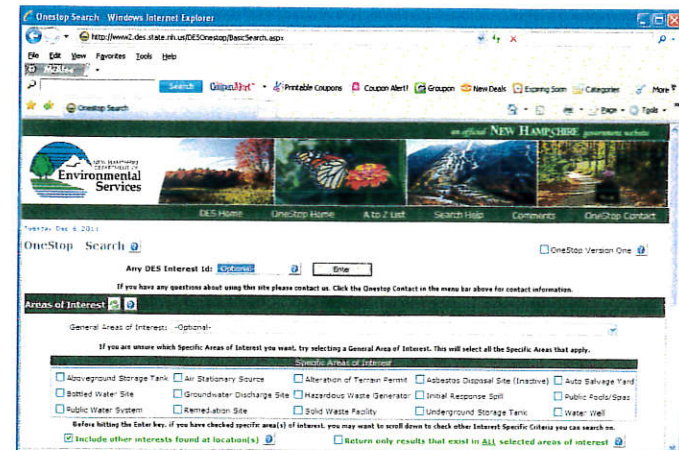

Type in your public water system number and click enter